


Alarm Trips and Switches

A7: Open Circuit Detection for a 4-20mA Input

Problem: I need a low pressure alarm on my instrument air system, but I can't afford to have a system shutdown if the pressure transmitter fails and the header pressure is still acceptable. I also want to use the signal for monitoring in the Control Room.

Solution: A SPA Site-Programmable Alarm with a dual relay and analog output will do the job. Set Relay 1 with a time delay to close when the header pressure falls below an acceptable level and Relay 2 to open if the pressure transmitter fails so a shutdown will not occur.

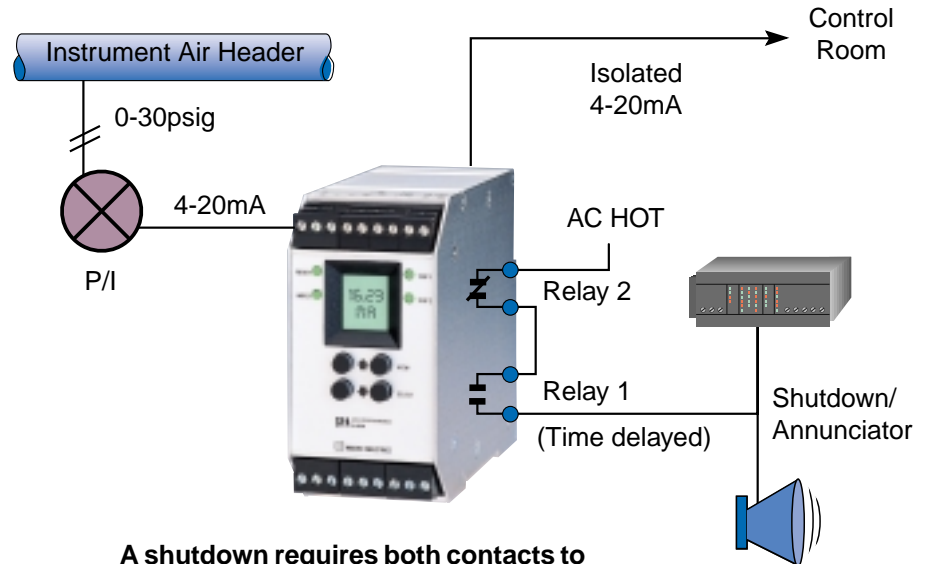

A shutdown requires both contacts to be closed indicating the transmitter is working and the pressure is low

Model Number Example

SPA / HLPRG / 2PRG / U / -AO [DIN]