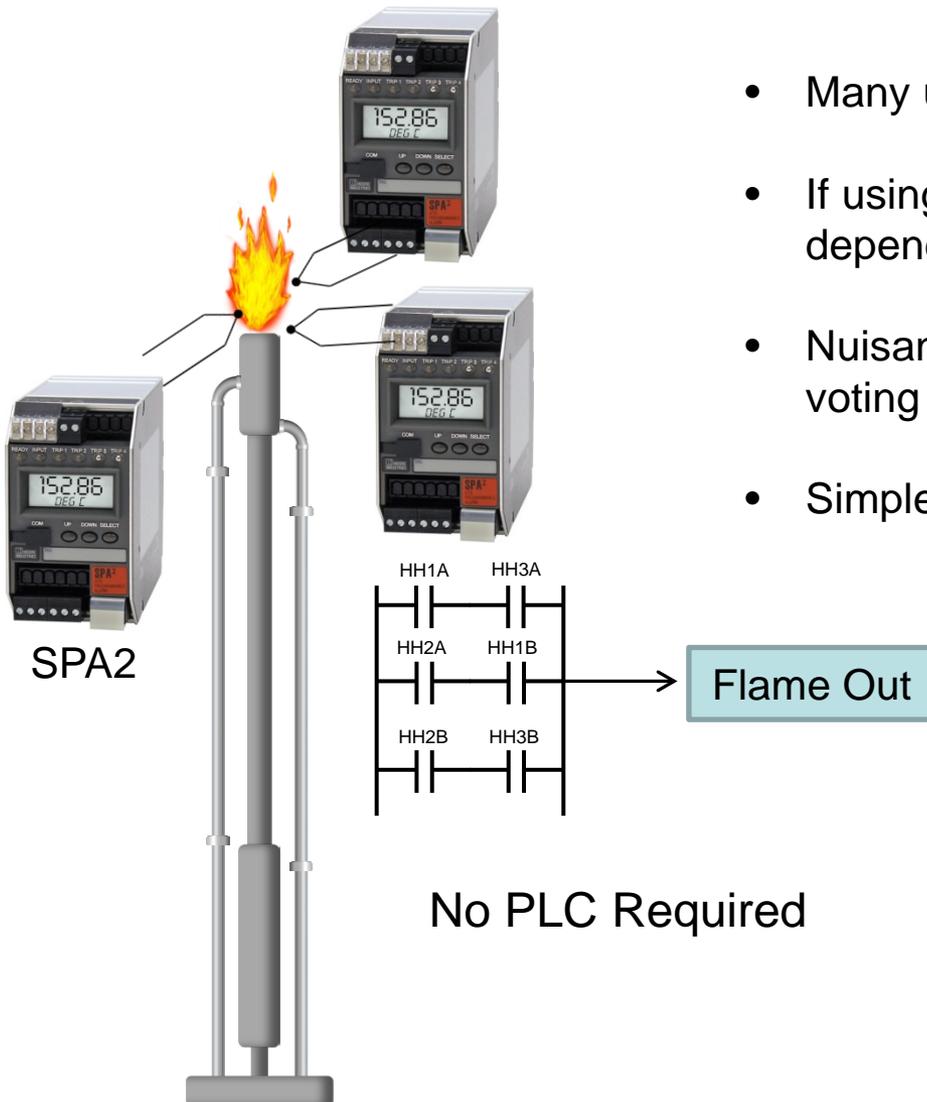# Flare Stack Monitoring

SPA2

- Many use a TC to detect the presence of a flame

- If using a single TC it could come up cold depending upon the direction of the wind

- Nuisance trips are very expensive – use 2oo3 voting to improve system integrity

- Simple solution…easily supported

No PLC Required

Flame Out

MOORE INDUSTRIES WORLDWIDE