# MOORE INDUSTRIES WORLDWIDE

Cathodic Protection Monitoring System

CPMS

#### November 2021

## Description


The CPMS Cathodic Protection Monitoring System monitors above and below ground impressed current cathodic protection systems to ensure that proper corrosion protection is in place and operating at the right levels.

Part of Moore Industries' NET Concentrator System<sup>®</sup> family of intelligent distributed I/O, the CPMS monitors the critical current and voltage levels of one or two transformer rectifiers used in cathodic protection systems. Each module provides four or eight, fully-isolated analog input channels and four discrete (contact closure) inputs. It "concentrates" this data onto one or multiple communication links, and transmits it long distances back to one or more host DCS, PLC or PC-based control systems.

Alarm Inputs— The CPMS accepts up to four discrete (contact closure) inputs from the monitored system. Using an internal control engine, the CPMS can be programmed with internal set points that relate to normal operating conditions within the cathodic protection system. Should monitored parameters go outside of selected limits, or if power to the cathodic protection system is lost, the CPMS alerts of the unwanted conditions at the control system over the data link.

**Expansion I/O & GPS**—In addition to operating in a stand-alone mode, the CPMS integrates with any of Moore Industries' NET Concentrator System's analog, temperature, discrete and relay I/O modules (see Pages 4 and 7). When coupled with the ROM (Relay Output Module), relay outputs can control rectifiers using accurate GPS time to facilitate taking cathodic protection reference electrode readings.

*Figure 1.* The stand-alone CPMS accepts four or eight analog inputs and four discrete (contact closure) inputs.

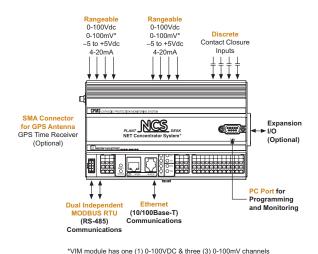



**The DIN-rail mount CPMS** features rugged metal construction that stands up to the daily rigors of demanding process and factory automation applications.

### **Features**

- Simultaneous dual MODBUS RTU and Ethernet communications. The CPMS comes standard with dual MODBUS RTU (RS-485) ports and one Ethernet (MODBUS/TCP) port.
- MODBUS RTU master capability. One or both of the CPMS MODBUS RTU (RS-485) ports can be configured as MODBUS master ports.
- Installs in harsh environments. The CPMS features rugged metal construction, superior RFI/EMI protection and an industry-best ambient operating temperature of -40°C to +85°C (-40°F to +185°F).
- Quick and simple programming. Using the Internet Explorer web browser, all input and operating parameters can be selected and set in minutes.
- Data logger with battery back-up. For historical performance trending and analysis, the CPMS can archive up to 64,000 time and date stamped values.
- Advanced control and math capabilities. Using ISaGRAF Control Engine Software from ICS Triplex, the CPMS delivers complex control, such as PID, and computation functions (see Page 8 for details).
- **GPS Time feature.** The GPS Time feature provides an optional method for keeping accurate time when an SNTP network is not available.


CE Conformant—EMC Directive 2014/30/EU; Low Voltage Directive 2014/35/EU

© 2021 Moore Industries-International, Inc. 289-710-01E

### **MODBUS RTU Network Master or Slave**

Each CPMS MODBUS RTU (RS-485) port can be programmed to act as a master or slave within a network (each port is configured by the factory as a MODBUS slave port). When set as the master, the module performs all network polling functions. This includes polling of up to 32 (without repeaters) CPMS stations, Moore Industries NET Concentrator System stations and/or third-party MODBUS slave devices per port. The CPMS will handle up to 64 slave devices if both MODBUS RTU ports are used. With repeaters, additional CPMS stations and MODBUS slave devices can be integrated into a network to accommodate hundreds of monitoring and control points.

Figure 2. In this CIM module example, the CPMS monitors the analog and discrete signals critical for tracking impressed current cathodic protection systems.

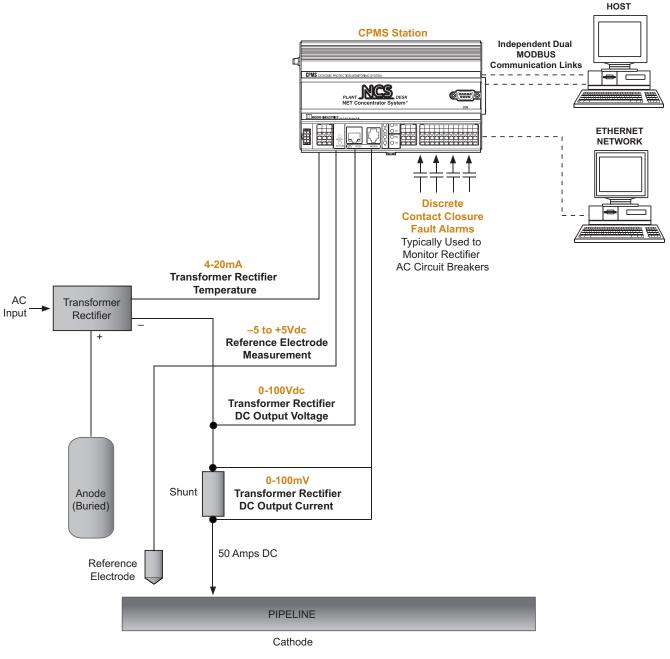

\* All product names are the property of their respective companies.

NCS and NET Concentrator System are registered trademarks of Moore Industries-International, Inc.

### Cathodic Protection Monitoring System

## **System Architecture**

The CPMS can be used to send just a few, or hundreds of, process signals between the field and a control system. Industrially-hardened and configurable interface stations mount throughout a site, or in dispersed locations throughout the world, to provide cost-effective distributed data acquisition and, with expansion I/O, control capabilities (see Pages 4 and 7).

The saves time and money when used in place of hard-wired schemes. Concentrate just a few, or hundreds of process signals, onto a single digital data link. This saves cable, conduit, connection, and wire tray costs. You can even use an existing Ethernet and/or MODBUS network, and eliminate the time and expense of creating a new network.

A CPMS network is made up of one or more standalone stations. Any combination of NCS NET Concentrator System distributed I/O expansion modules may be used within a CPMS station.

The CPMS' peer-to-host architecture provides a cost-effective method to transfer monitoring and control signals to and from a host DCS, PLC or PC-based system. CPMS stations are distributed along a MODBUS RTU serial and/or Ethernet (MODBUS/TCP) network. Once the data is delivered to the host system, third-party HMI or SCADA software packages can be used to create user interface strategies that may include data


acquisition, alarm summary and management, data -logging, historical data collection and trending and supervisory control functions.

# Simultaneous Dual MODBUS RTU and Ethernet Communications

The CPMS communicates its data using dual MODBUS RTU data links and standard Ethernet.

**Dual MODBUS RTU Networks**—When the CPMS uses MODBUS for communications, each of its two MODBUS ports can be set up as a master or as a slave. The ports can also be set up identically to provide network redundancy. Up to 64 (32 per MOD-BUS port) CPMS stations and/or third-party MODBUS devices can be distributed throughout a plant multidropped on the dual MODBUS RS-485 data links (without repeaters). Depending on the type of expansion I/O modules used, a station can accommodate just a few or as many as 124 points when using expansion I/O (see Pages 4 and 7). With repeaters, additional CPMS stations and MODBUS devices can be added to a system.

**Ethernet (IEEE 802.3) Communications**—The number of CPMS stations that can be used on an Ethernet (MODBUS/TCP) network is limited only by the architecture of a specific network (taking into account the physical limitations of Ethernet). Standard industrial Ethernet switches or hubs are available to interconnect large numbers of CPMS stations. Ethernet switches also minimize message collisions, improving determinism in the Ethernet network (Figure 3).

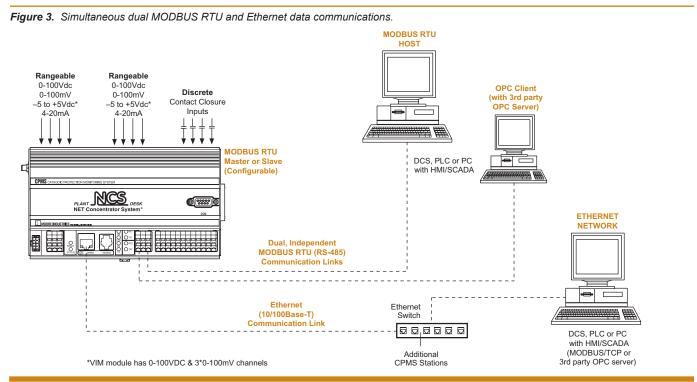

# **CPMS** Cathodic Protection Monitoring System

**Figure 4.** Expansion I/O (see Page 7) allows each stand-alone CPMS station to handle up to 124 signals in a MODBUS network. The number of CPMS stations that can be used in a Ethernet network is limited only by the architecture of a specific network (taking into account the physical limitations of Ethernet).

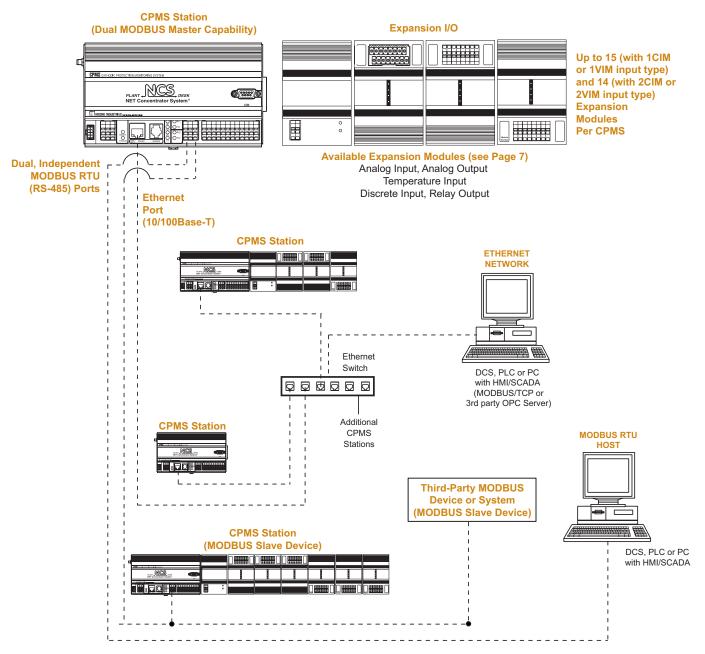


Table 1. Long-Term Stability

Error (% of maximum	Input (Years)				
span)	1	3	5		
Current Inputs	0.08	0.14	0.18		
Voltage Inputs	0.09	0.16	0.21		

#### Table 2. Normal Mode Rejection Ratio

Input	Max. p-p signal injection for 60dB at 50/60Hz
Current	20mA
0 to 100mV	10mV
-5 to 5V	1V
0 to 100V	10V

CPMS Cathodic Protection Monitoring System

# **Specifications**

#### Communications

#### ETHERNET Ethernet Port:

10/100Base-T supports speeds up to 100Mb/second. Standard RJ-45 Connection Auto negotiation, Auto MDIX, DHCP or fixed IP address **Protocol Type:** MODBUS/TCP

#### MODBUS:

Type: Two independently configurable RS-485 ports (according to EIA-485, 1993)

**Protocol Type:** MODBUS RTU **Baud Rates:** 1200, 2400, 4800, 9600, 19.2k, 38.4k and 57.6k (userselectable; default is 9600)

Parity: Even, Ódd or No Parity (1 stop bit, fixed; default is No Parity) Device Address: 1-255 (Default is 1) Character Timeout: 5, 10, 25, 50,100, 200 and 255 character times (userselectable; factory set to default) Response Delay: 1-255 character times (user-selectable; factory set to default)

Discrete Inputs: Contact Closure: 24V@3.7mA, internally powered Input Logic Threshold: 8V lowgoing; 16V high-going Maximum Input Over Range: 24Vdc Signal Response Time: 15mS

#### Performance

#### Analog Inputs:

Input Accuracy: Current, ±0.1% of 20mA span; Voltage, ±0.1% of maximum span Stability: Refer to Table 1

Filter Configuration: 50/60Hz rejection selection (userselectable)

Input Channel Update Time: 150msec Data Access Time: Time to detect or effect a change in an I/O signal from a MODBUS master polling a CPMS is the sum of 3 timing components: 1. Network Communication Time: Depends on network architecture and traffic. For a PC locally networked to a CPMS, this time is negligible 2. Scan Time: Time required by the CPMS to scan real-time data in all I/O modules connected to it (see Module Scan Time specification for each I/O module type and add times for each I/O module connected to the CPMS) 3. Signal Response Time: Time to

convert between physical I/O and digital signals (see specification for specific I/O type) Isolation: 1000Vrms between case, input, output, each MODBUS port, each discrete input channel and power, continuous, and will withstand a 1200Vac dielectric strength test for one minute (with no breakdown). 500Vrms between analog input channels. **Power Supply:** 

24Vdc, 20-30Vdc; Uac, 90-260Vac **Power Consumption:** Vdc, 7.0W maximum; Uac, 8.0W maximum **Input Impedance:** Current, 20 ohms, nominal; Voltage, 10 Mohms, nominal **Maximum Input Over Range:** Current inputs, ±100mA, maximum; 0 to 100mV inputs, ±250Vdc, maximum; -5 to 5V inputs, ±200Vdc, maximum; 0 to 100V inputs, 200Vdc, maximum **Diagnostic Data:** Refer to Installation Manual

#### **Status and Fault Indicators**

#### System:

**READY:** Green when ready; Off when not ready; Red during CPU reset

**STATUS:** Green when OK; Red when not OK

#### Ethernet:

Firmware Version 5.0.00 or greater LINK/ACT: This LED indicates transmit and receive activity in addition to the status of the Link. The LED will be ON when Link is good. It will blink when the transmitter or receiver is active. **SPEED:** This LED is ON when the Ethernet connection is 100 Mb/s and OFF when it is 10 Mb/s. Firmware version prior to 5.0.00 LINK: Amber LED indicates a network link is present **ACT:** Flashes green in response to data

reception and transmission MODBUS:

TX1: Green blinks when Transmit activity on MODBUS 1 occurs; Off when no Transmit activity on MODBUS 1 RX1: Green blinks when Receive activity on MODBUS 1 occurs; Off when no Receive activity on MODBUS 1 TX2: Green blinks when Transmit activity on MODBUS 2 occurs; Off when no Transmit activity on MODBUS 2 RX2: Green blinks when Receive activity on MODBUS 2 occurs; Off when no Receive activity on MODBUS 2 **TX:** Green blinks when Transmit activity on Remote COM occurs; Off when no Transmit activity on Remote COM RX: Green blinks when Receive activity on Remote COM occurs; Off when no Receive activity on Remote COM

**DCD:** Green when Remote COM connection is established; Off when no Remote COM connection is present

DTR: Green when modem/

GSM/radio connection is active and status is OK; Off when no modem/GSM/radio connection active; Red blinks when radio alarm is occuring.

#### System Time Accuracy

#### Real Time Clock (RTC):

±1 Minute/Month (when not connected to an authoritative time source) **SNPT/GPS:** <100ms of authoritative time source

#### Data Logger

Records up to 64,000 timestamped data points; minimum sample period, 100msec; maximum sample period, 24 hour Non-volatile memory holds timestamped data; measurement parameters are software configurable; 18,000 data points stored in BBRAM

#### Ambient Conditions

**Operating Range:** -40°C to +85°C (-40°F to +185°F) Storage Range: -50°C to +100°C (-58°F to +212°F) Relative Humidity: 0-95%, non-condensing Ambient Temperature Effect: 100ppm of full scale/°C **RFI/EMI Protection:** 20V/m@80-1000MHz, 1kHz AM when tested according to EN61326 with errors of 0.5% or span or less Noise Rejection: Common Mode: 100dB@50/60Hz: Normal Mode: Refer to Table 2

#### Weight

1.26 kg (44.3 oz)

# **Ordering Information**

Unit	Input	Output	Power	Options	Housings
CPMS Cathodic Protection Monitoring System Module	<ul> <li>1CIM Four rangeable cathodic protection monitoring channels with four discrete (contact closure) input channels (see Table 3)</li> <li>2CIM Eight rangeable cathodic protection monitoring channels with four discrete (contact closure) input channels (see Table 3)</li> <li>1VIM Four rangeable voltage input channels with four discrete (contact closure) input channels (see Table 4)</li> <li>2VIM Eight rangeable voltage input channels with four discrete (contact closure) input channels (see Table 4)</li> </ul>	<b>COM</b> Redundant (Dual) MODBUS RTU (RS-485) communication links and one Ethernet (MODBUS/TCP) communication link	20-30VDC UAC Accepts any range between 90- 260Vac	-GPST GPS time receiver option allows the CPMS to set its internal time clock to GPS satellite network; SMA female connector	DIN Aluminum DIN-style rail-mount housing mounts on G-type (EN50035) and 35mm Top Hat (EN50022) rails

To order, specify: Unit / Input / Output / Power / Options [Housing] Model number examples: CPMS / 2CIM / COM / 20-30VDC / -GPST [DIN]

 Table 3.
 Input Channel Designations with Typical Measurement Descriptions

 for CPMS Cathodic Protection Monitoring System Module (Analog Channels 1-4

 are for the 1CIM Input Type; Analog Channels 1-8 are for the 2CIM Input Type).

		Input Type	Description			
	1	0-100Vdc	Measures DC Output Voltage of Transformer Rectifier #1			
	2	0-100mV*	Measures DC Output Current of Transformer Rectifier #1			
lels	3	_5 to +5Vdc	Measures DC Output of Reference Electrode for Rectifier #1			
Solution     Measures DC Output of Reference Electrode f       4     4-20mA     User-Assigned for Specific Application or Ter Transformer Rectifier #1       5     0-100Vdc     Measures DC Output Voltage of Transformer       6     0-100mV*     Measures DC Output Current of Transformer		User-Assigned for Specific Application or Temperature of Transformer Rectifier #1				
D D	5	0-100Vdc	Measures DC Output Voltage of Transformer Rectifier #2			
lalo	6	0-100mV*	Measures DC Output Current of Transformer Rectifier #2			
An	7	_5 to +5Vdc	Measures DC Output of Reference Electrode for Rectifier #2			
	8	4-20mA	User-Assigned for Specific Application or Temperature of Transformer Rectifier #2			
lels	1 Contact Monitors the Status of the AC Closure Rect		Monitors the Status of the AC Circuit Breaker of Transformer Rectifier #1			
hanr	2	Contact Closure	Monitors the Status of the AC Circuit Breaker of Transformer Rectifier #2			
Discrete Channels	3	Contact Closure	User-Assigned for Specific Application			
Disc	4	Contact Closure	User-Assigned for Specific Application			

\*Current is measured in mV across a shunt resistor.

# **System Accessories**

The following technology is available from 3rd parties.

Industrial Ethernet Switches—Intelligent multi-port communications switches automatically determine and remember where a CPMS is located, and routes messages only through the appropriate port to that Station. This minimizes network loading and improves deterministic communications over Ethernet.

Ethernet Routers—Connects multiple CPMS segments or subnetworks, forwards messages from one network to another, and provides message traffic isolation between segments.

RS-485 to RS-232C/RS-422 Converter—For MODBUS RTU (RS-485) networks, converts the RS-485 signal to either RS-232C or RS-422 standard to allow direct interface with a modem or computerbased systems, such as a PC.

RS-485 to Fiber Optics Converter—Converts the CPMS module's RS-485 signal to light for signal transmission over a fiber optic cable. See Page 7 for Expansion I/O Ordering Information

 Table 4.
 Input Channel Designations with Typical Measurement Descriptions

 for CPMS Cathodic Protection Monitoring System Module (Analog Channels 1-4

 are for the 1VIM Input Type; Analog Channels 1-8 are for the 2VIM Input Type).

		Input Type	Description
1		0-100Vdc	Measures DC Output Voltage of Transformer Rectifier #1
<u>v</u>	2	0-100mV*	Measures DC Output Current of Transformer Rectifier #1
nne	3	0-100mV*	Measures DC Output Current of Transformer Rectifier #1
hai	4	0-100mV*	Measures DC Output Current of Transformer Rectifier #1
0 0	5	0-100Vdc	Measures DC Output Voltage of Transformer Rectifier #2
Analog Channels	6	0-100mV*	Measures DC Output Current of Transformer Rectifier #2
A	7	0-100mV*	Measures DC Output Current of Transformer Rectifier #2
	8	0-100mV*	Measures DC Output Current of Transformer Rectifier #2
lels	1 Contact Monitors the Status of the AC Circuit Break Closure Rectifier #1		Monitors the Status of the AC Circuit Breaker of Transformer Rectifier #1
hanr	2	Contact Closure	Monitors the Status of the AC Circuit Breaker of Transformer Rectifier #2
Discrete Channels	3 Contact Closure		User-Assigned for Specific Application
		Contact Closure	User-Assigned for Specific Application

\*Current is measured in mV across a shunt resistor.

Ethernet/RS-485 Repeater—Repeaters are available to extend the typical reach of Ethernet and RS-485..

Wireless RF Modems—Where wires can't be run for practical or economic reasons, spread spectrum wireless radio (RF) communication provides accurate and reliable connectivity between sites. Distances between modems can be up to 20 miles, and repeaters can extend coverage even further (see the WLM Wireless Link Module data sheet for details).

Short Haul Modem—Some short haul modems convert to a different signal type to gain greater distances over copper.

**Data Line (Surge) Protectors**—Mounts on a G-type rail next to the CPMS to protect the data link from damaging voltage and current surges caused by lightning, welding, heavy electrical equipment and switch gears.

**Instrument Power Supplies**—Moore Industries offers a complete line of instrument power supplies for mounting alongside and powering the CPMS.

CPMS

Cathodic Protection Monitoring System

## **Expansion I/O**

The CPMS integrates with any of Moore Industries' NET Concentrator System's analog, temperature, discrete and relay distributed I/O modules. Using just one CPMS module with expansion I/O, up to 124 signal inputs and outputs can be transmitted long distances on one low cost data communication link. Expansion I/O programs using the Internet Explorer web browser via Ethernet, using the PC port. All operating parameters can be viewed, selected and set in minutes. See the NCS NET Concentrator System data sheet for details.

#### **Important Note:**

If the CPMS is a 4-channel input model (1CIM or 1VIM), it will supply power to one additional expansion I/O module. If additional expansion I/O modules will be used in a station, a CPM Concentrator Power Module is required (see Ordering Information below). If the CPMS is an 8-channel input model (2CIM or 2VIM), a CPM is required to power any additional NCS expansion I/O in a station. The CPM may be installed at any position within a CPMS station. It works in conjunction with the CPMS to power up to eight expansion I/O modules. If more than 8 I/O modules are used in a station, two CPMs will be needed. The CPM will only power units that are mounted to its left (from the user's front view perspective, this would be the right side of the CPM).

> For specifications and additional information on expansion I/O, see "Module Types" in the NCS NET Concentrator System data sheet.

# **Ordering Information (Continued)**

Unit	Module Type	Input/Output Configuration	Power	Options	Housing
INPUT/OUTP	UT MODULES (U	p to 15 Maximum per CPMS with 1CIM or 1VIM input	t, 14 with 2	CIM or 2VIM in	put)
AIM* Analog Input Module	IO Input/Output Module	<b>Al4</b> Four Configurable Analog Input Channels (0-20mA, -10V to 10V)	<b>IP</b> Input and Output	-NB Spare or replacement Input/Output Module Electronics without the Mounting Base -NM Spare or replacement Mounting Base without Input/Output Module Electronics	DIN Aluminum DIN-style rail-mount housing mounts on 35mm Top Hat (EN50022) rails. (for mounting to G-Type DIN rails, request the G-type DIN Rail Adapter, PN 209-832- 00)
AOM* Analog Output Module	IO Input/Output Module	<b>AO4</b> Four Configurable Analog Output Channels (0-20mA, 0-10V)	Modules are powered		
TIM* Temperature Input Module	IO Input/Output Module	<b>TI4</b> Four Configurable Temperature Input Channels (RTD, T/C, mV, ohms, Pot; see Table 1 for details)	by the CPMS or CPM		
gg <b>DIM*</b> Discrete Input Module	IO Input/Output Module	<b>CC8</b> Eight Discrete Contact Closure Input Channels (24V/3.7mA, internally-powered)	Module (see the note above)		
		<b>HV8</b> Eight Discrete Voltage Input Channels (High Range: 120/240Vac)			
		<b>LV8</b> Eight Discrete Voltage Input Channels (Low Range: 30Vac/Vdc)			
<b>ROM</b> * Relay Output Module	<b>IO</b> Input/Output Module	t <b>RNC8</b> Eight (Normally Closed) Relay Output Channels, SPST relay, 1 form A , rated 2A@250Vac, 50/60Hz, non-inductive or 2A@30Vdc		*Input/Output Modules come with a Mounting Base unless the -NB or -NM option is specified.	
		<b>RNO8</b> Eight (Normally Open) Relay Output Channels SPST relay, 1 form B, rated 2A@250Vac, 50/60Hz, non-inductive or 2A@30Vdc			
	P	OWER SUPPLY MODULE (See Important Note Above	e)		
СРМ	20-30Vdc	NCSPWR Up to Eight I/O Modules (See Important		No Options	DIN (see

To order, specify: Unit / Module Type / Input/Output Configuration / Power / Options [Housing]

Note above)

Model number examples (see the NCS NET Concentrator System data sheet for additional examples and information): Analog Output Module

AOM / IO / AO4 / IP [DIN]

Concentrator

Power Module

Temperature Input Module TIM / IO / TI4 / IP [DIN] description

above)

Cathodic Protection Monitoring System

# **System Advantages**

### Fast and Simple Set Up

The CPMS employs a web browser-based configuration interface which is used to configure and retrieve information. You can change operating parameters over your intranet (or the internet) from any PC, with proper security password clearance. Programming can be performed over the Ethernet data link, using the PC port.

### **Compatible with HMI and SCADA Software**

Once the data is delivered to the host PC or DCS, leading third-party HMI software packages can be used to create custom data acquisition and control strategies.

### **Data Logging Capabilities**

CPMS stations are capable of storing 64,000 points of time-stamped data. A station can be configured to store data from one, or all, of its input channels. Sampling rate is user-selectable for any period between once every 100 milliseconds, to once every 24 hours.

### On-Line Diagnostics Speed Troubleshooting

The CPMS continuously monitors its inputs, the data link and itself, to identify and report potential problems to the control system.

### **Advanced Control and Math Capabilities**

Using ISaGRAF Control Engine Software from ICS Triplex (available from Moore Industries), the CPMS can be configured to deliver additional control, computation, and functional capabilities including:

- The ability to act as a single or multiple PID loop controller with simple, cascade, split action and inverse capabilities.
- Sequential control language programmability based on IEC 61131-3, including ladder, function block diagrams, and structured text, sequential flow charts and instruction list.
- Complex math capabilities including: add, subtract, multiply, divide; absolute value; square root; integrate and totalize; exponential; natural logarithm, base<sub>10</sub> logarithm; comparison; sine, cosine and tangent; arc sine, arc cosine and arc tangent.

### Precise Digital Input and Output Trimming

To produce highly accurate readings, analog input channels and analog output channels (with expansion I/O) can be precisely trimmed to essentially eliminate measurement errors introduced by the input and compensate for readout device inaccuracies.

Figure 5. CPMS Dimensions (see the NCS NET Concentrator System data sheet for installation dimensions for expansion I/O).

